
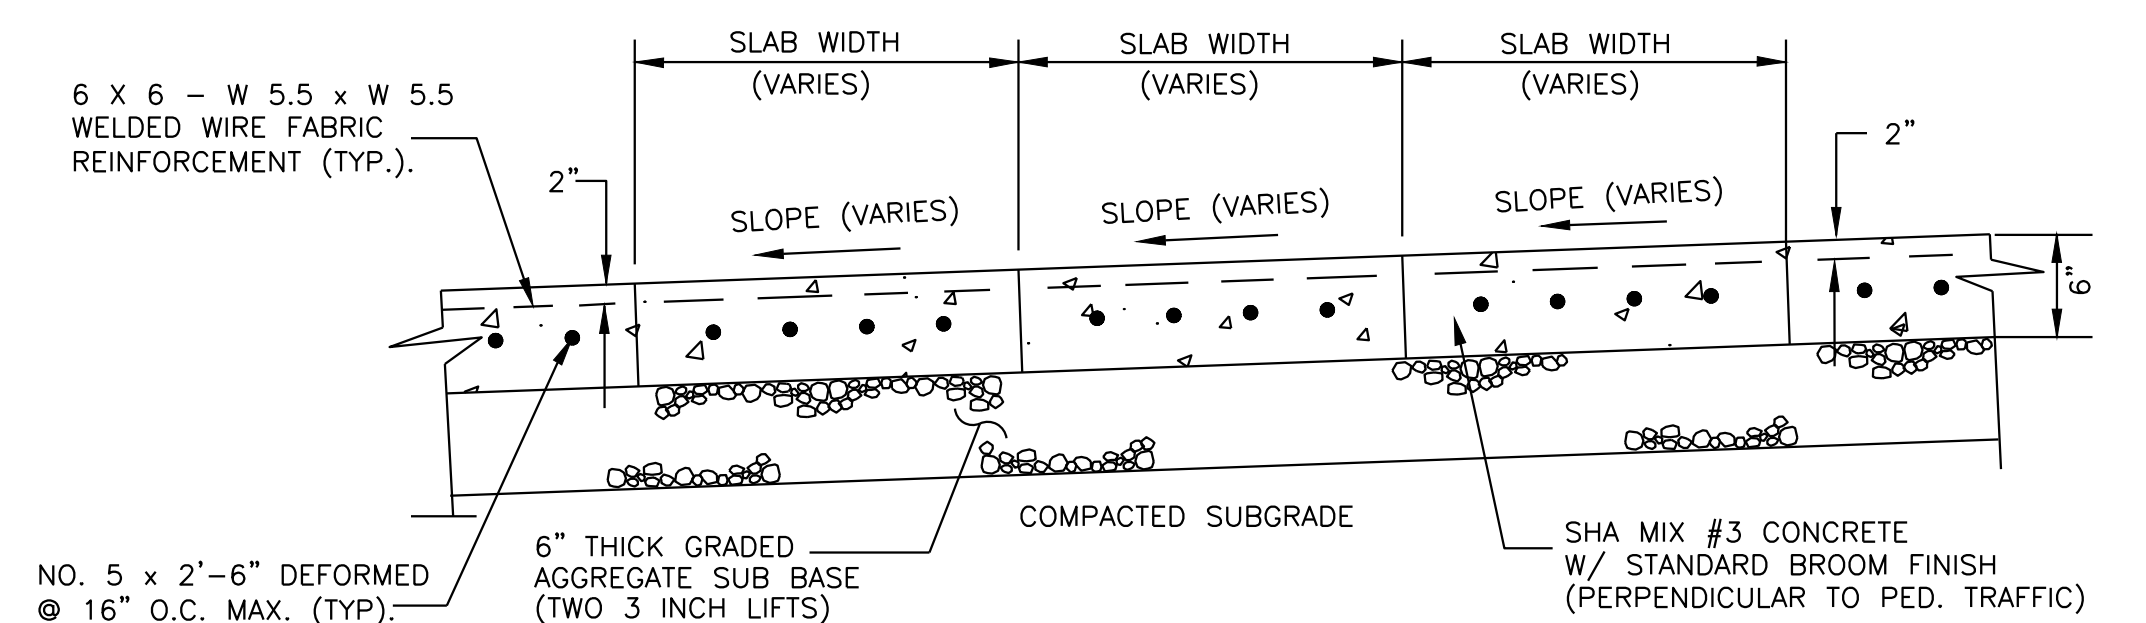


SITE KEYNOTES


1. NEW CONCRETE PAVEMENT, SEE DET. 1 BELOW
2. NEW BRICK PAVEMENT (SEE SHEET L-100)
3. SITE LIGHTING (SEE SHEET EL-002)

SITE LEGEND

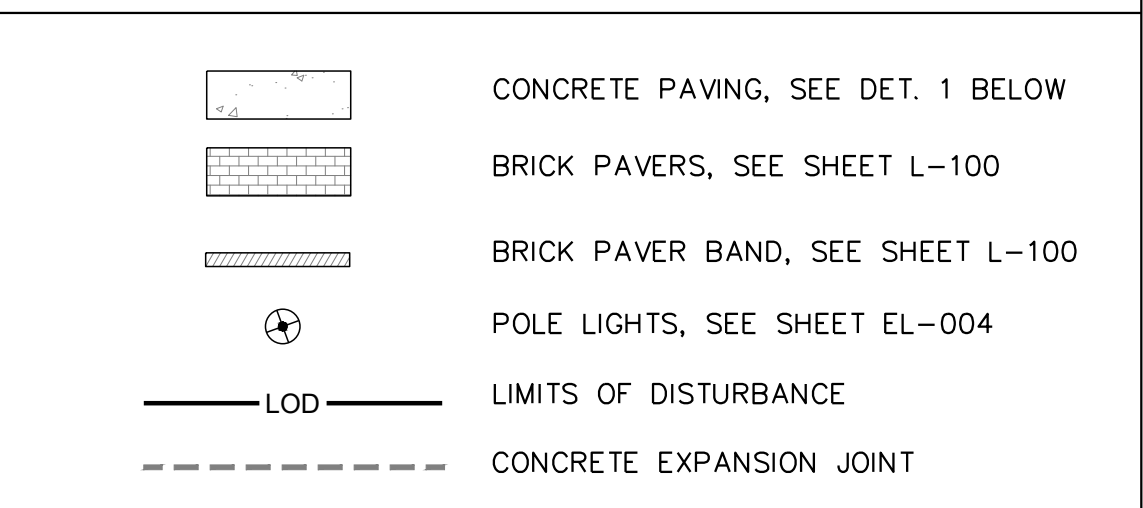

- NOTES:**
1. No. 5 x 2'-6" DEFORMED TIE BARS @ 16" O.C.
 2. JOINT WIDENING AND JOINT SEALANT REQUIRED AT ALL JOINTS, SEE SPECIFICATIONS.
 3. CONTRACTOR TO PROVIDE SHOP DRAWING WITH JOINT LAYOUT, ELEVATIONS AND SURFACE FINISH DETAILS.
 4. MAXIMUM CONTINUOUS SLAB AREA NOT TO EXCEED 400 SQ. FT. MAXIMUM SLAB DIMENSION RATIO NOT TO EXCEED 2:1.


1 CONCRETE PAVING
SCALE: NTS

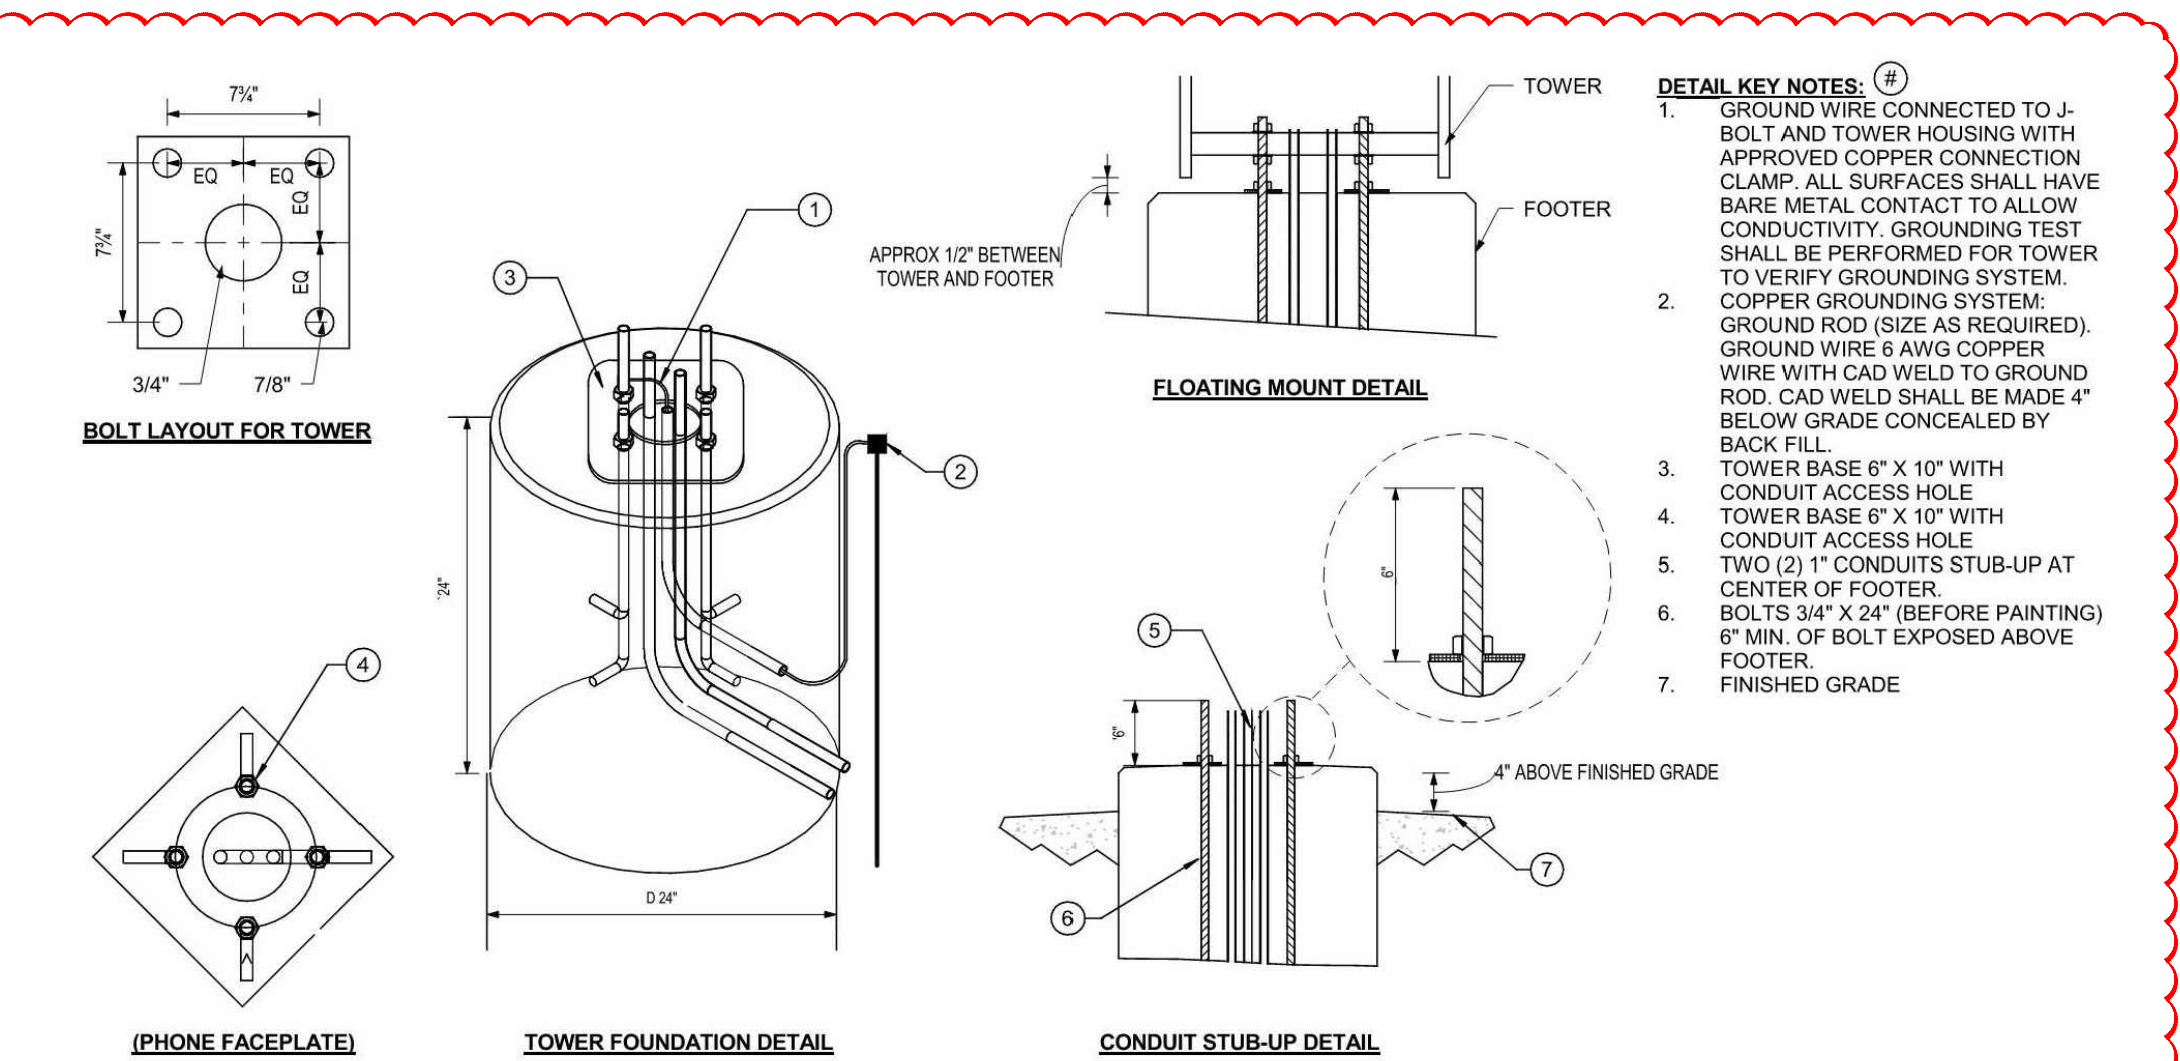

2 EMERGENCY CALLBOX BASE DETAIL
SCALE: NTS

- DETAIL KEY NOTES:**
1. GROUND WIRE CONNECTED TO J-BOLT AND TOWER HOUSING WITH APPROVED COPPER CONNECTION CLAMP. ALL SURFACES SHALL HAVE BARE METAL CONTACT TO ALLOW CONDUCTIVITY. GROUNDING TEST SHALL BE PERFORMED FOR TOWER TO VERIFY GROUNDING SYSTEM.
 2. COPPER GROUNDING SYSTEM: GROUND ROD (SIZE AS REQUIRED). GROUND WIRE 6 AWG COPPER WIRE WITH CAD WELD TO GROUND ROD. CAD WELD SHALL BE MADE 4" BELOW GRADE CONCEALED BY BACK FILL.
 3. TOWER BASE 6" X 10" WITH CONDUIT ACCESS HOLE.
 4. TOWER BASE 6" X 10" WITH CONDUIT ACCESS HOLE.
 5. TWO (2) 1" CONDUITS STUB-UP AT CENTER OF FOOTER.
 6. BOLTS 3/4" X 24" (BEFORE PAINTING) 6" MIN. OF BOLT EXPOSED ABOVE FOOTER.
 7. FINISHED GRADE.

MATCHLINE - SEE SHEET CS-101



KEY PLAN

REV	DATE	DESCRIPTION
		RECORD SET
1	05/10/2024	BID ADDENDUM #01
	02/12/2024	100% CONSTRUCTION SET
	12/08/2023	90% CONSTRUCTION SET
	10/26/2023	50% CONSTRUCTION SET
	08/24/2023	DESIGN DEVELOPMENT
	06/13/2023	SCHEMATIC DESIGN

DATE: 02/12/2024 SCALE: 1"=10'

SITE LAYOUT PLAN 2

X:\ROCKVILLE\17-0782.011 - HARBOR HALL COURTYARD DESIGN\05-CAD\CS102_23-126.DWG, 5/10/2024 8:24 AM, MMWYCHULLIS